

# CERTIFICATE OF CONFORMITY

## Product Listing Scheme: Scheme Type 5

**This certificate is issued to:** Allegion (Southeast Asia) Pte Ltd  
31 Ubi Road 1  
#07-01  
Singapore 408694

**Registration Number/UEN:** 200007123E

**Product:** Controlled Door Closing Device  
(Surface Mounted Door Closer)

**Brand:** CISA

**Model:** C2010.03

**Country of Origin:** Taiwan

**Product Details:** Fixed power sized rack and pinion surface mounted door closer  
without back check function with sliding arm  
Suitable for use on 60mins uninsulated fire rated doors  
Classification of Coding System:

4	8	3	1	1	0
---	---	---	---	---	---

See COC Appendix (1 page) for more details


**Standard(s):** SS 332:2018 Clause 6 (Annex C)

**Report(s):** TÜV SÜD PSB No. 7191245409-MEC20/01-JT

This certificate issued in accordance with SCDF Fire Code 2018 requirements.



Head of Certification

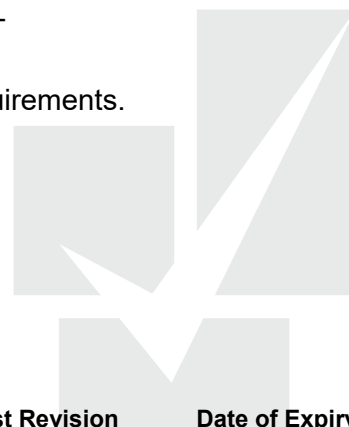

<b>Certificate No.</b> 20A0360	<b>Date of Original Issue</b> 10 December 2020	<b>No. of Page(s)</b> 1 of 2	<b>Date of Last Revision</b> -	<b>Date of Expiry</b> 09 December 2025
-----------------------------------	---	---------------------------------	-----------------------------------	---



# APPENDIX

**Product Details:** Fixed power sized Rack and pinion surface mounted door closer without back check function with sliding arm  
**Classification of coding system for surface mounted door closer as per below**

<u>1st Digit</u> Category of Use	<u>2nd Digit</u> Test Duration	<u>3rd Digit</u> Door Closer Power Size	<u>4th Digit</u> Fire Resistance	<u>5th Digit</u> Essential requirements of safety use	<u>6th Digit</u> Corrosion Resistance
4	8	3	1	1	0
<b>Grade 4</b> For closing door from 180°	<b>Grade 8</b> 500,000 cycles	<b>Power Sizes: 3</b> Can be used on fire rated doors	<b>Grade 1</b> <b>*Suitable for 60mins uninsulated fire rated doors.</b>	<b>Grade 1</b> Satisfied essential requirements of safety use	<b>Grade 0</b> no defined corrosion resistance

Please refer to TÜV SÜD PSB No. 7191241140-MEC20-LC.

**Note:** For surface-mounted door closers, the selected door closer shall meet the performance requirements needed for the respective fire-rated door, in accordance with SS 332 Cl 6 Annex C or EN 1154. Surface-mounted door closers tested with uninsulated fire-rated doors can be installed on insulated or uninsulated fire-rated doors (subject to the maximum fire-rating attained by the door closer in a fire test). Surface-mounted door closers tested with insulated fire-rated doors can only be installed on insulated fire-rated doors

Head of Certification

<b>Certificate No.</b> 20A0360	<b>Date of Original Issue</b> 10 December 2020	<b>No. of Page(s)</b> 2 of 2	<b>Date of Last Revision</b> -	<b>Date of Expiry</b> 09 December 2025
-----------------------------------	---	---------------------------------	-----------------------------------	---